


# ATTACHMENT A

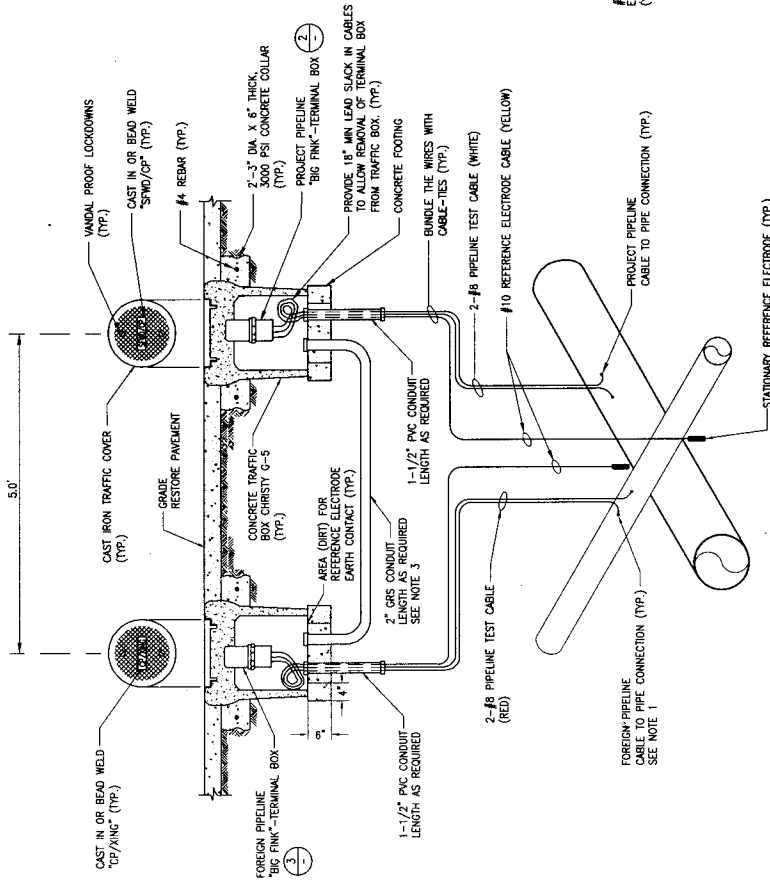


**NOTES:**

1. COORDINATE WITH FOREIGN UTILITY OWNER PRIOR TO CABLEWELDED TEST LEADS TO THE FOREIGN PIPELINE.
2. ALL CONDUITS SHALL HAVE BISHING AT EACH END.
3. THIS CONDUIT IS FOR FUTURE CATHODIC PROTECTION INTERFERENCE MITIGATION OF THE TWO PIPELINES AT THE CROSSING. INSTALL 4 #10 AWG WIRES WITH COLORS AS FOLLOWS: 1. RED, 2. WHITE, 3. YELLOW, 4. BLACK. WIRE SHALL EXTEND 2' BEYOND EACH END OF THE CONDUIT.

**FOREIGN PIPELINE CROSSING TEST STATION DIAGRAM**

D E T A I L 1  
NOT TO SCALE

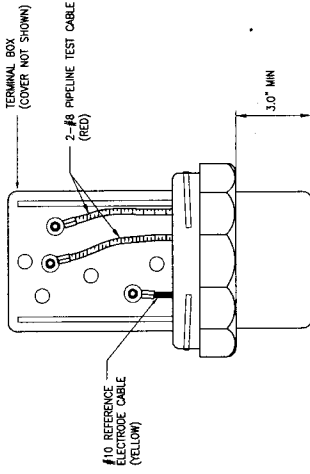


**NOTES:**

1. COVER OF THE TERMINAL BOX IS NOT SHOWN FOR CLARITY.
2. SEAL THE END OF THE LOWER PIECE OF THE TERMINAL BOX WITH DUXSEAL SEALING PUTTY.

**"BIG FINK"-TERMINAL BOX**

D E T A I L 3  
NOT TO SCALE

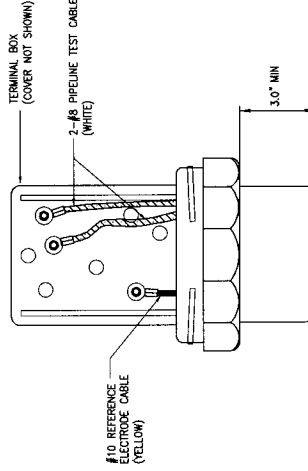

**NOTES:**

1. COVER OF THE TERMINAL BOX IS NOT SHOWN FOR CLARITY.
2. SEAL THE END OF THE LOWER PIECE OF THE TERMINAL BOX WITH DUXSEAL SEALING PUTTY.

**"BIG FINK"-TERMINAL BOX**

D E T A I L 2  
NOT TO SCALE